

☐ **G1825** Eyewash, Pedestal Mounted, Stainless Steel Bowl☐ **G1825P** Eyewash, Pedestal Mounted, Plastic Bowl

**Application:** Free standing, pedestal mounted eyewash. Two GS-Plus™ spray-type spray heads deliver a flood of water for rinsing eyes.

**Spray Head Assembly:** Two GS-Plus<sup>™</sup> spray heads. Each head has a "flip top" dust cover, internal flow control and filter to remove impurities from the water flow.

**Valve:** 1/2" IPS chrome plated brass stay-open ball valve. Valve is US-made with chrome plated brass ball and Teflon® seals.

**Bowl:** 11-1/2" diameter. Bowl is stainless steel (G1825) or orange ABS plastic (G1825P).

**Pipe and Fittings:** Schedule 40 galvanized steel. Furnished with orange polyethylene covers for vertical piping for high visibility and corrosion resistance.

**Supply:** 1/2" NPT female inlet. **Waste:** 1-1/4" NPT female outlet.

**Sign:** ANSI-compliant identification sign.

**Quality Assurance:** Valve, bowl and spray head assembly is factory assembled and water tested prior to shipment.


## **Available Options**


| <b>BC</b> Stainless steel bowl cover (G1825 only). Cover protects unit against contaminants. Cover is automatically raised when unit is activated.   |
|--|
| <b>DC</b> Stainless steel dust cover for each spray head.  |
| <b>HFC</b> Hand and foot control. Eyewash is activated by flag handle or foot treadle.   |
| <b>HS</b> Auxiliary hand-held drench hose for rinsing eyes, face or body.  |
| <b>SC</b> Self-closing ball valve. <i>Note: Eyewashes with self-closing valves do not comply with ANSI Z358.1-2014.</i>  |
| <b>TMV</b> G3600LF thermostatic mixing valve precisely blends hot and cold water to deliver warm (tepid) water as required by ANSI Z358.1-2014. Refer to "Tempering Units" section for complete technical and product selection information. |





☐ **G1825** Eyewash, Pedestal Mounted, Stainless Steel Bowl ☐ **G1825P** Eyewash, Pedestal Mounted, Plastic Bowl

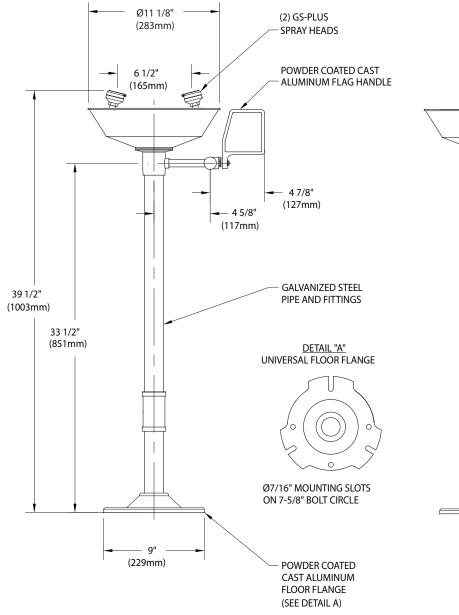

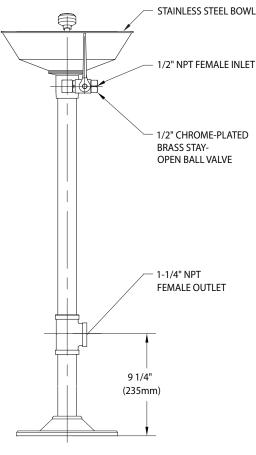

EACH GS-PLUS SPRAY HEAD HAS A

"FLIP-TOP" DUST COVER, INTERNAL

IMPURITIES FROM THE WATER FLOW.

FLOW CONTROL AND FILTER TO REMOVE

THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL

Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are  $\pm$  1/4" (6mm). rev. 0115 Sign Included



NOTE:

