

## □ **G1848** Eyewash, Wall Mounted, AutoFlow<sup>™</sup> 90° Swing-Down



**Application:** AutoFlow<sup>™</sup> eyewash for mounting on wall. Spray heads swing down from storage to operational position, activating water flow. Available in a variety of spray head configurations to minimize obstructions at a sink. *Note: If unit is not installed at a sink, floor drain should be provided underneath unit to prevent accumulation of water on floor.* 

**Spray Head Assembly:** Two GS-Plus<sup>™</sup> spray heads. Each head has a "flip top" dust cover, internal flow control and filter to remove impurities from the water flow.

**Valve:** 1/2" IPS plug-type valve with PTFE coated O-ring seals. Swinging head assembly from storage to operational position opens orifice and activates water flow. Unit remains in operation until head assembly is returned to storage position.

**Strainer:** Unit is furnished with in-line strainer to protect valve and spray heads from debris in water line.

**Mounting:** Valve is installed in Type 316 stainless steel housing. Mount housing on wall using anchors or other mounting hardware.

**Construction:** Polished chrome plated brass.

Supply: 1/2" NPT female inlet.

Sign: ANSI-compliant identification sign.

**Quality Assurance:** Unit is completely assembled and water tested prior to shipment.

## **Available Options**

- **DC** Stainless steel dust cover for each spray head.
- G3600LF Thermostatic mixing valve precisely blends hot and cold water to deliver warm (tepid) water as required by ANSI Z358.1-2014. Refer to "Tempering Valves" section for complete technical and product selection information.


Guardian Equipment 1140 N North Branch St Chicago, IL 60642

312 447 8100 TELEPHONE 312 447 8101 FACSIMILE gesafety.com Listed 8116. Units have been tested to and comply with ANSI Z358.1-2014 and the Uniform Plumbing Code.





## □ **G1848** Eyewash, Wall Mounted, AutoFlow<sup>™</sup> 90° Swing-Down

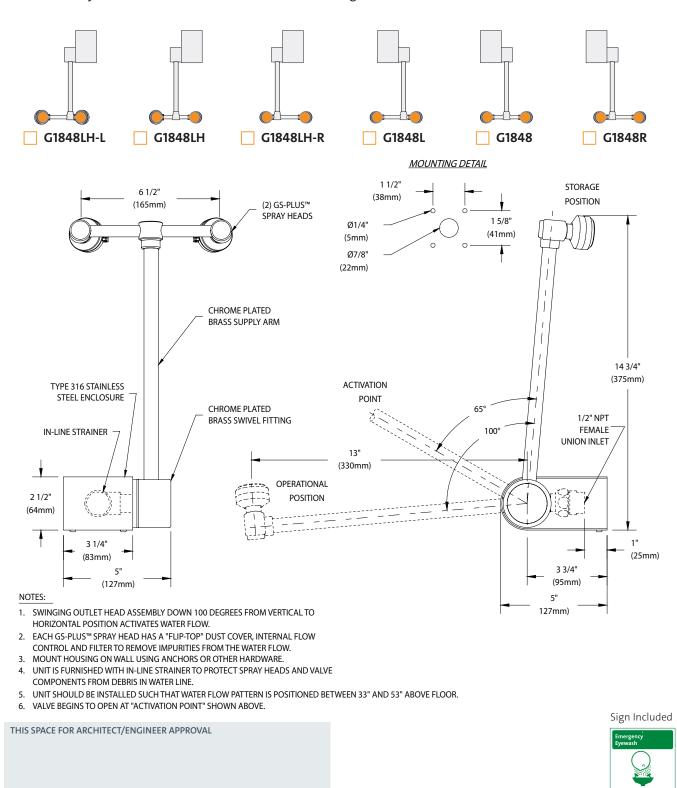

Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are  $\pm$  1/4" (6mm). rev. 0617

Listed 8116. Units have been tested to and comply with ANSI Z358.1-2014 and the Uniform Plumbing Code.

