



## G1991 Safety Station with Eyewash, All-Stainless Steel Construction

Application: All-stainless steel combination eyewash and shower safety station. Stainless steel construction is ideal for highly corrosive environments and clean room applications. Two GS-Plus<sup>™</sup> spray-type outlet heads deliver a flood of water for rinsing eyes.

Shower Head: 10" diameter stainless steel.

Shower Valve: 1" IPS Type 316 stainless steel stay-open ball valve. Valve has stainless steel ball and Teflon® seals. Furnished with stainless steel actuating arm and 29" stainless steel pull rod.

Spray Head Assembly: Two GS-Plus<sup>™</sup> spray heads. Each head has a "flip top" dust cover, internal flow control and filter to remove impurities from the water flow.

Eyewash Bowl: 11-1/2" diameter stainless steel.

Eyewash Valve: 1/2" IPS Type 316 stainless steel stay-open ball valve. Valve has stainless steel ball and Teflon® seals.

Pipe and Fittings: Schedule 40 Type 304 brushed stainless steel. Furnished with orange polyethylene covers for vertical piping for high visibility and corrosion resistance.

Supply: 1-1/4" NPT female top or side inlet.

Waste: 1-1/4" NPT female outlet.

Sign: Furnished with ANSI-compliant identification sign.

Quality Assurance: Valve and spray head assemblies are factory assembled and water tested prior to shipment.

## **Available Options**

Guardian Equipment

Chicago, IL 60642

1140 N North Branch St 312 447 8101 FACSIMILE

- **BC** Stainless steel cover for eyewash wash bowl.
- **FC20** Regulates shower flow rate to 20 GPM.

## AP275-100 Electric Light and Alarm Horn

Light and alarm horn summon assistance when eyewash or shower is activated.

## AP250-015 Modesty Curtain

Modesty curtain for mounting on safety station.

**TMV** G3800LF thermostatic mixing valve precisely blends hot and cold water to deliver warm (tepid) water as required by ANSI Z358.1-2014.

312 447 8100 телерноме

gesafety.com





Listed 8116. Units have been





ETL Listed 101496. Units have been tested


to and comply with ANSI 7358.1-2014.

tested to and comply with ANSI Z358.1-2014 and the Uniform Plumbing Code. C







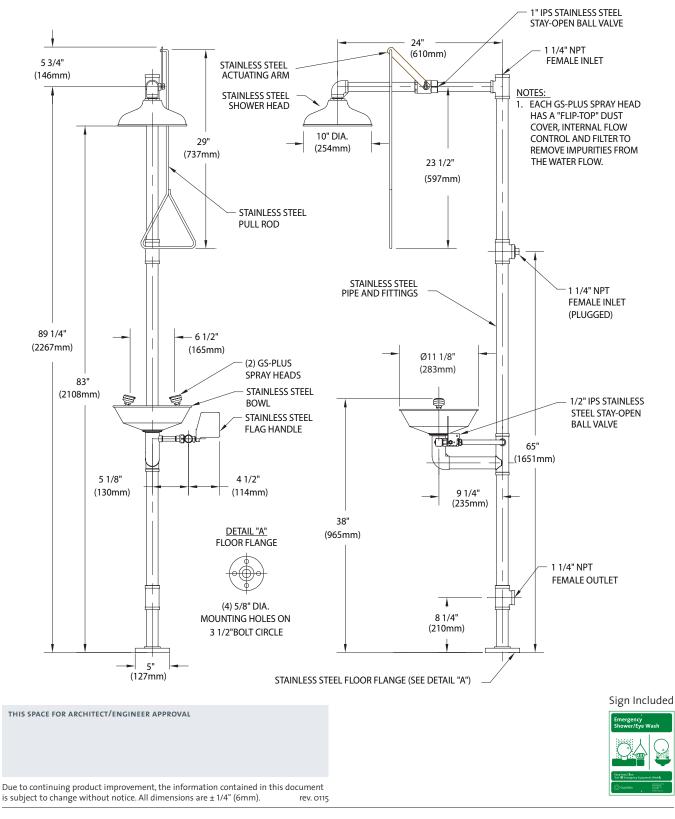

Guardian Equipment 1140 N North Branch St Chicago, IL 60642

312 447 8100 теlephone 312 447 8101 FACSIMILE gesafety.com

Listed 8116. Units have been tested to and comply with ANSI Z358.1-2014 and the Uniform Plumbing Code.





ETL Listed 101496. Units have been tested to and comply with ANSI Z358.1-2014.